


URS accepts no liability for the use of this drawing where it has been provided in electronic format, nor for any changes made to it following its issue. URS considers the printed version to be binding. A hard copy of this drawing is held on file by URS and may be provided if requested.

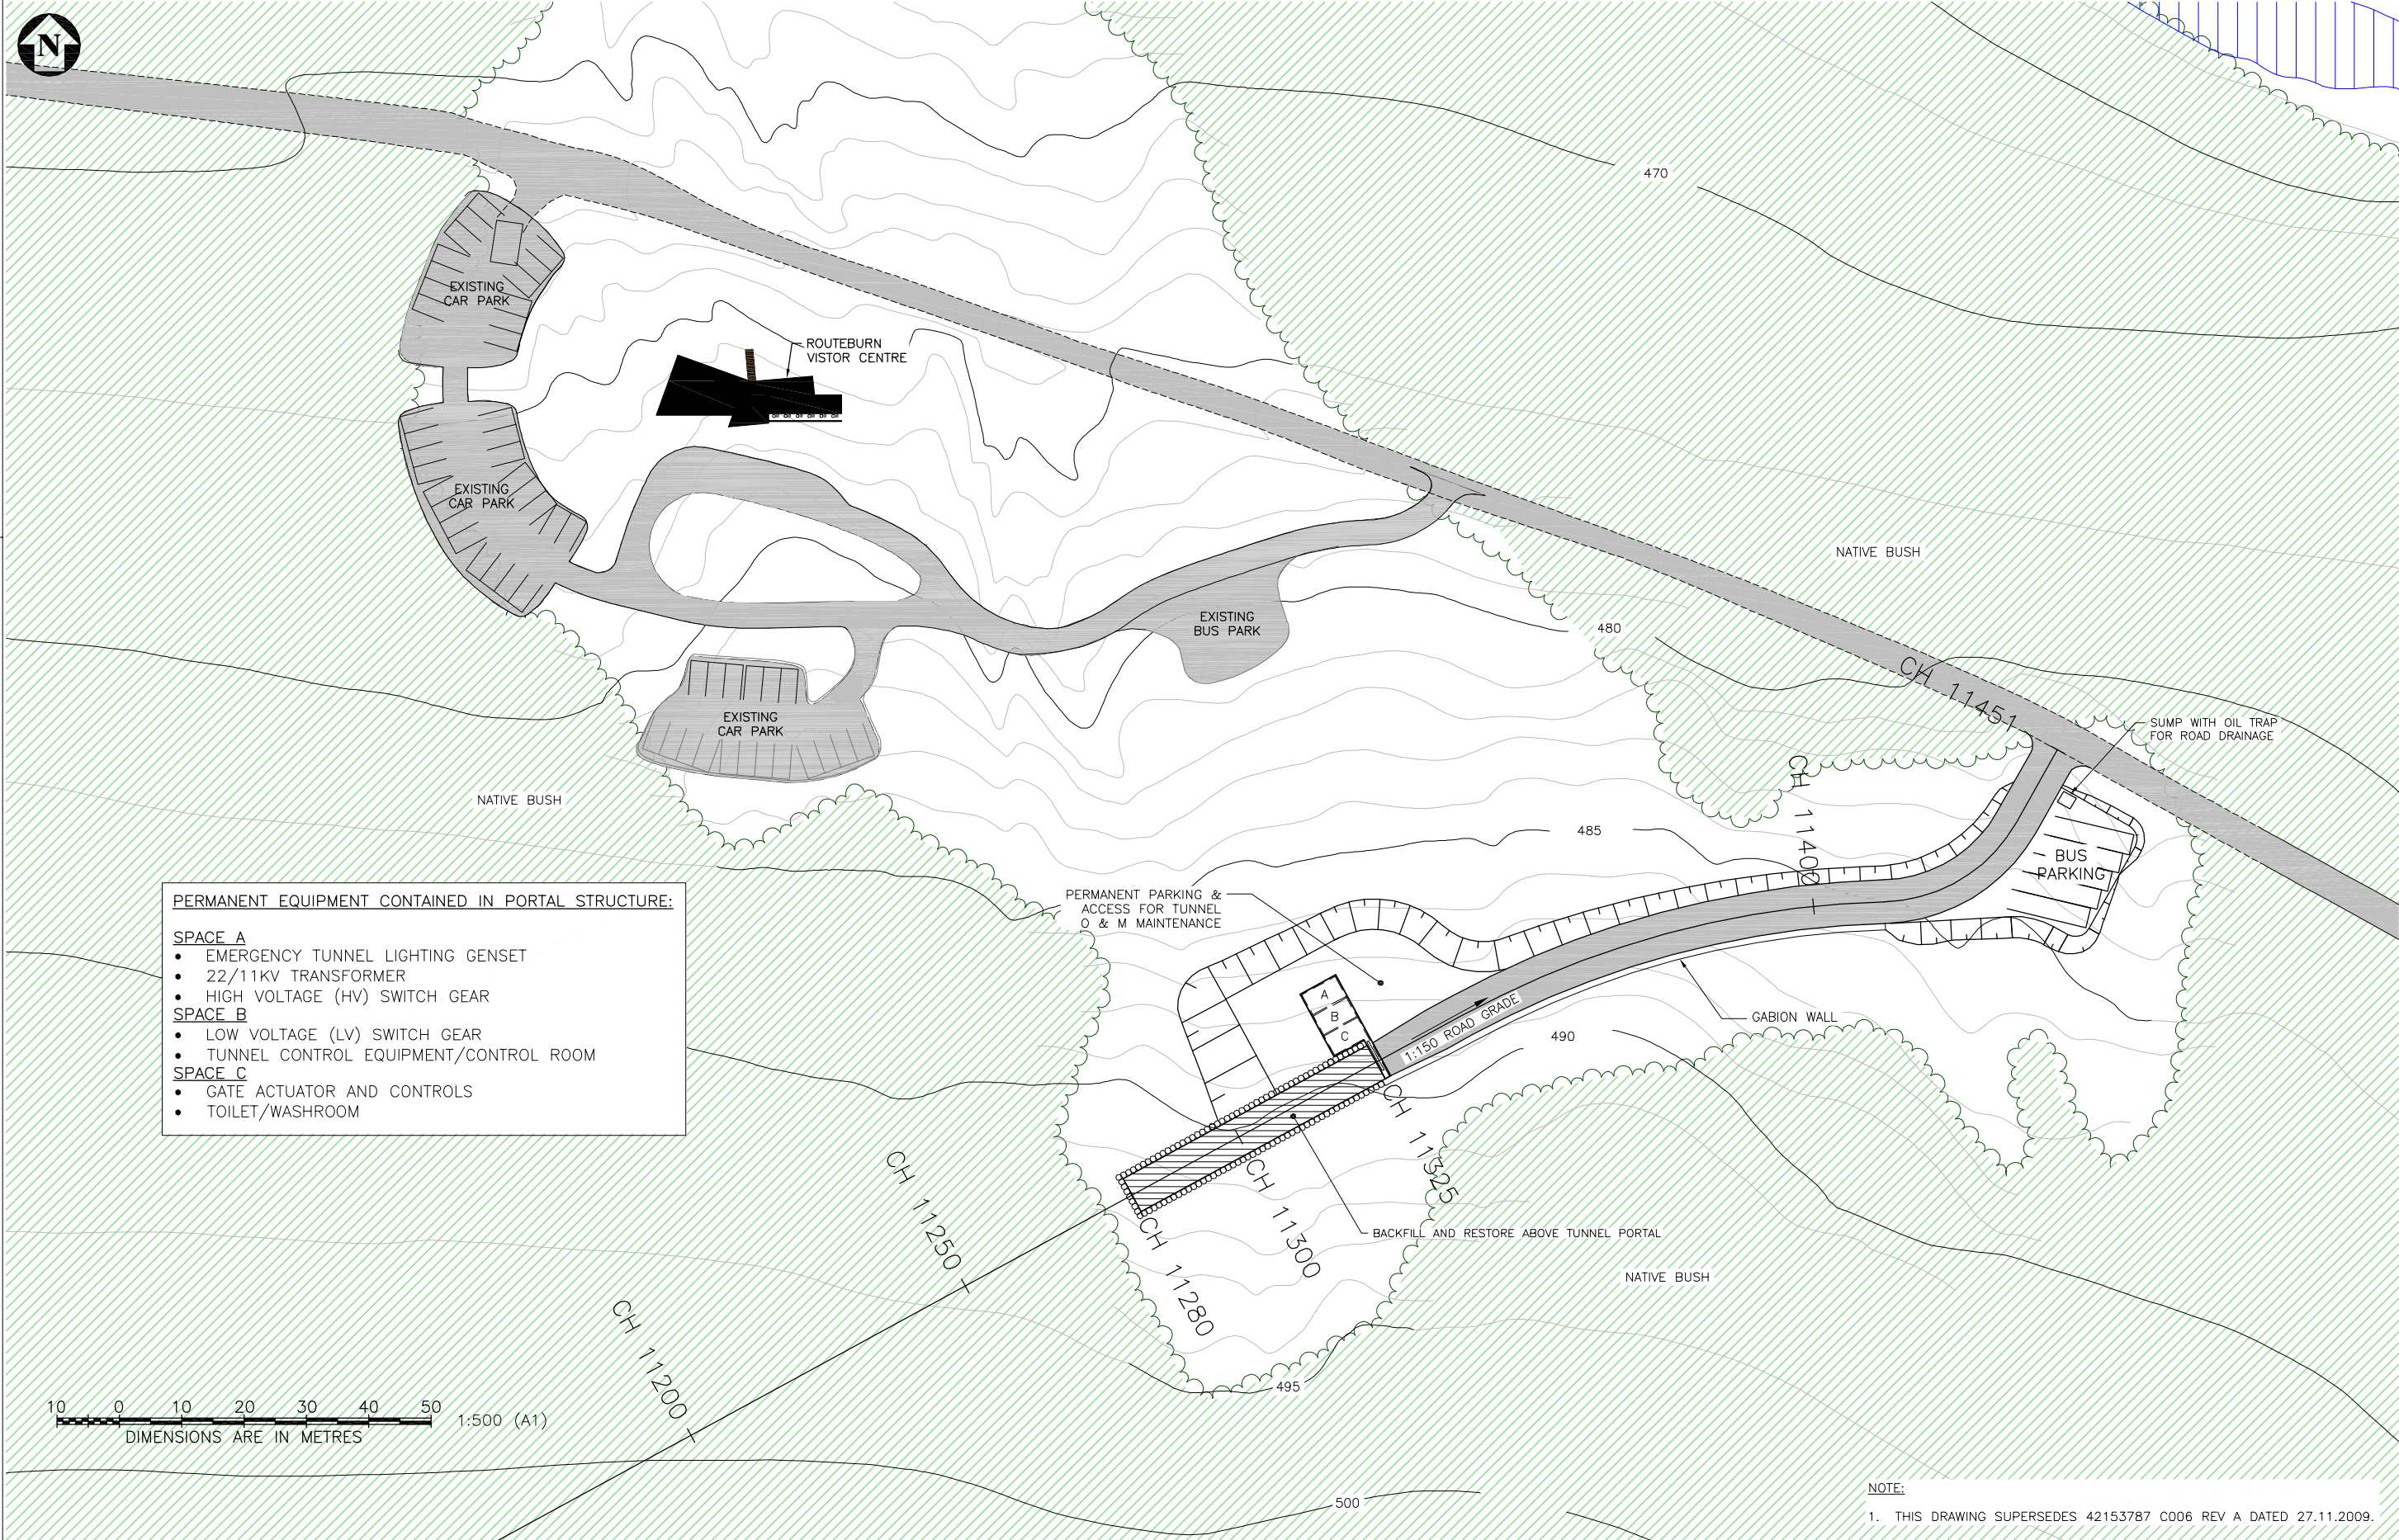

PERMANENT EQUIPMENT CONTAINED IN PORTAL STRUCTURE:

SPACE A

- EMERGENCY TUNNEL LIGHTING GENSET
- 22/11KV TRANSFORMER
- HIGH VOLTAGE (HV) SWITCH GEAR

SPACE B

- LOW VOLTAGE (LV) SWITCH GEAR
- TUNNEL CONTROL EQUIPMENT/CONTROL ROOM

SPACE C

- GATE ACTUATOR AND CONTROLS
- TOILET/WASHROOM

NOTE:
1. THIS DRAWING SUPERSEDES 42153787 C006 REV A DATED 27.11.2009.

						Tab	C203
						Scales	1:500(A1) 1:1000(A3)
						Original Size	A1
Rev	Revision Description	Designed	Drawn	Checked	Approved	Date	
-	FINAL ISSUE	RF	FLO	DMcF	RF	24.01.2011	



URS New Zealand Limited
Level 5, URS House
287 Durham Street, Christchurch
Phone: 3-374 8500
Fax: 3-377 0655



MILFORD DART PROJECT		
ROUTE BURN PORTAL POST CONSTRUCTION		Status FINAL
Drawing Number C203		Revision -